NOTE :
ALL RIGHTS RESERVED, THIS DRAWING OR ANY PART THEREOF NUST
NOT BE REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION
OF HIGHLAND TANK,
HIGHLAND TANK, SHALL BE RESPONSIBLE ONLY FOR ITEMS INDICATED
NO THIS FARRICATION DRAWING UNLESS OTHERWISE NOTED, DUSTONER
IS RESPONSIBLE FOR VERIFYING CORRECTIVESS OF SIZE / LIDEATION
OF FITTINGS , ACCESSORIES & COATINGS SHOWN ON THIS DRAWING

NOTE: POLYURETHANE ACT-100-U TANK IS NOT APPROVED FOR THE STORAGE OF HEATED PRODUCTS

MATE:
TANK HAS 30 YEAR LIMITED WARRANTY THROUGH STEEL TANK INSURANCE COMPANY

FITTING SCHEDULE


A= 3° 0 NPT WITH 3" x 2" NYLON BUSHING B= 3" 0 NPT WITH 3" x 2" NYLON BUSHING (FITTING FOR LEAK DETECTION W/ INTERNAL PIPE) C= 5" P NPT WITH 5" x 4" NYLON BUSHING

CAPACITY: 300 GALLONS
TYPE: 1 380 DOUBLE WALL, ACT—100—U, UNDERGROUND
NO. REO.:
MATERIAL: MILLI CARBON STEEL
TEST: 5 P.S.I.
MIN. CAUGE OR THICKNESS (PER LLL. 38):
(BASED ON 60" MAX.BURIAL DEPTH)
NNER HEADS: 7 GA.
OUTER HEADS: 10 GA.
NNER SHELL: 7 BA. OUTER SHELL: 10 GA.
PAINT:
INTERIOR: NONE


GENERAL NOTES

PAINT :
INTERIOR : NONE
EXTERIOR : SP-8 BLAST, COAT WITH 70 MLS DF
POLYURCHANE
CONSTRUCTION : FLAT FLANCED HEADS, LAP WELD ALL
EXTERIOR SEAMS ONLY
APPROVED LABELS : U.L. 38, ACT-100-U, H.T. STICKER

- 15000 VOLT SPARK TEST PROVIDED AT FACTORY



END VIEW

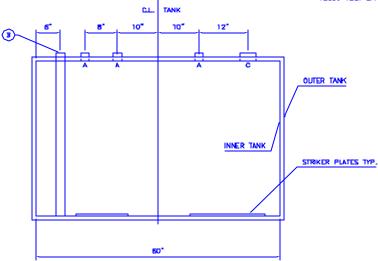

ELEVATION

103 SMITHTOWN BLVD SMITHTOWN, NY 11787

DRAWING TITLE

ACT-100U 300 GAL U/G TYPE 1 D/W

								REVISION DESCRIPTION
								¥
								DATE
								REV
							_	

ALL PROPTS RESERVED. THIS DRAWING OR ANY PART THEREOF NUST NOT BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION OF AREA—POWER UNITIZED FUELER, INC.

DMC NOSOD DMI	A100U 7			
SCALE: 3/4"=1"	DWN BY: HT			
SHEET: 1	DATE: 11/1/02			